


Building Engines
 THESE DRAWINGS WERE CREATED FOR EAP AND/OR FIRE SAFETY FILING ONLY. DRAWINGS ARE NOT TO SCALE & SHOULD NOT BE USED FOR CONSTRUCTION PURPOSES. EXISTING CONDITIONS MAY VARY.

PEARL STREET

PROSPECT STREET

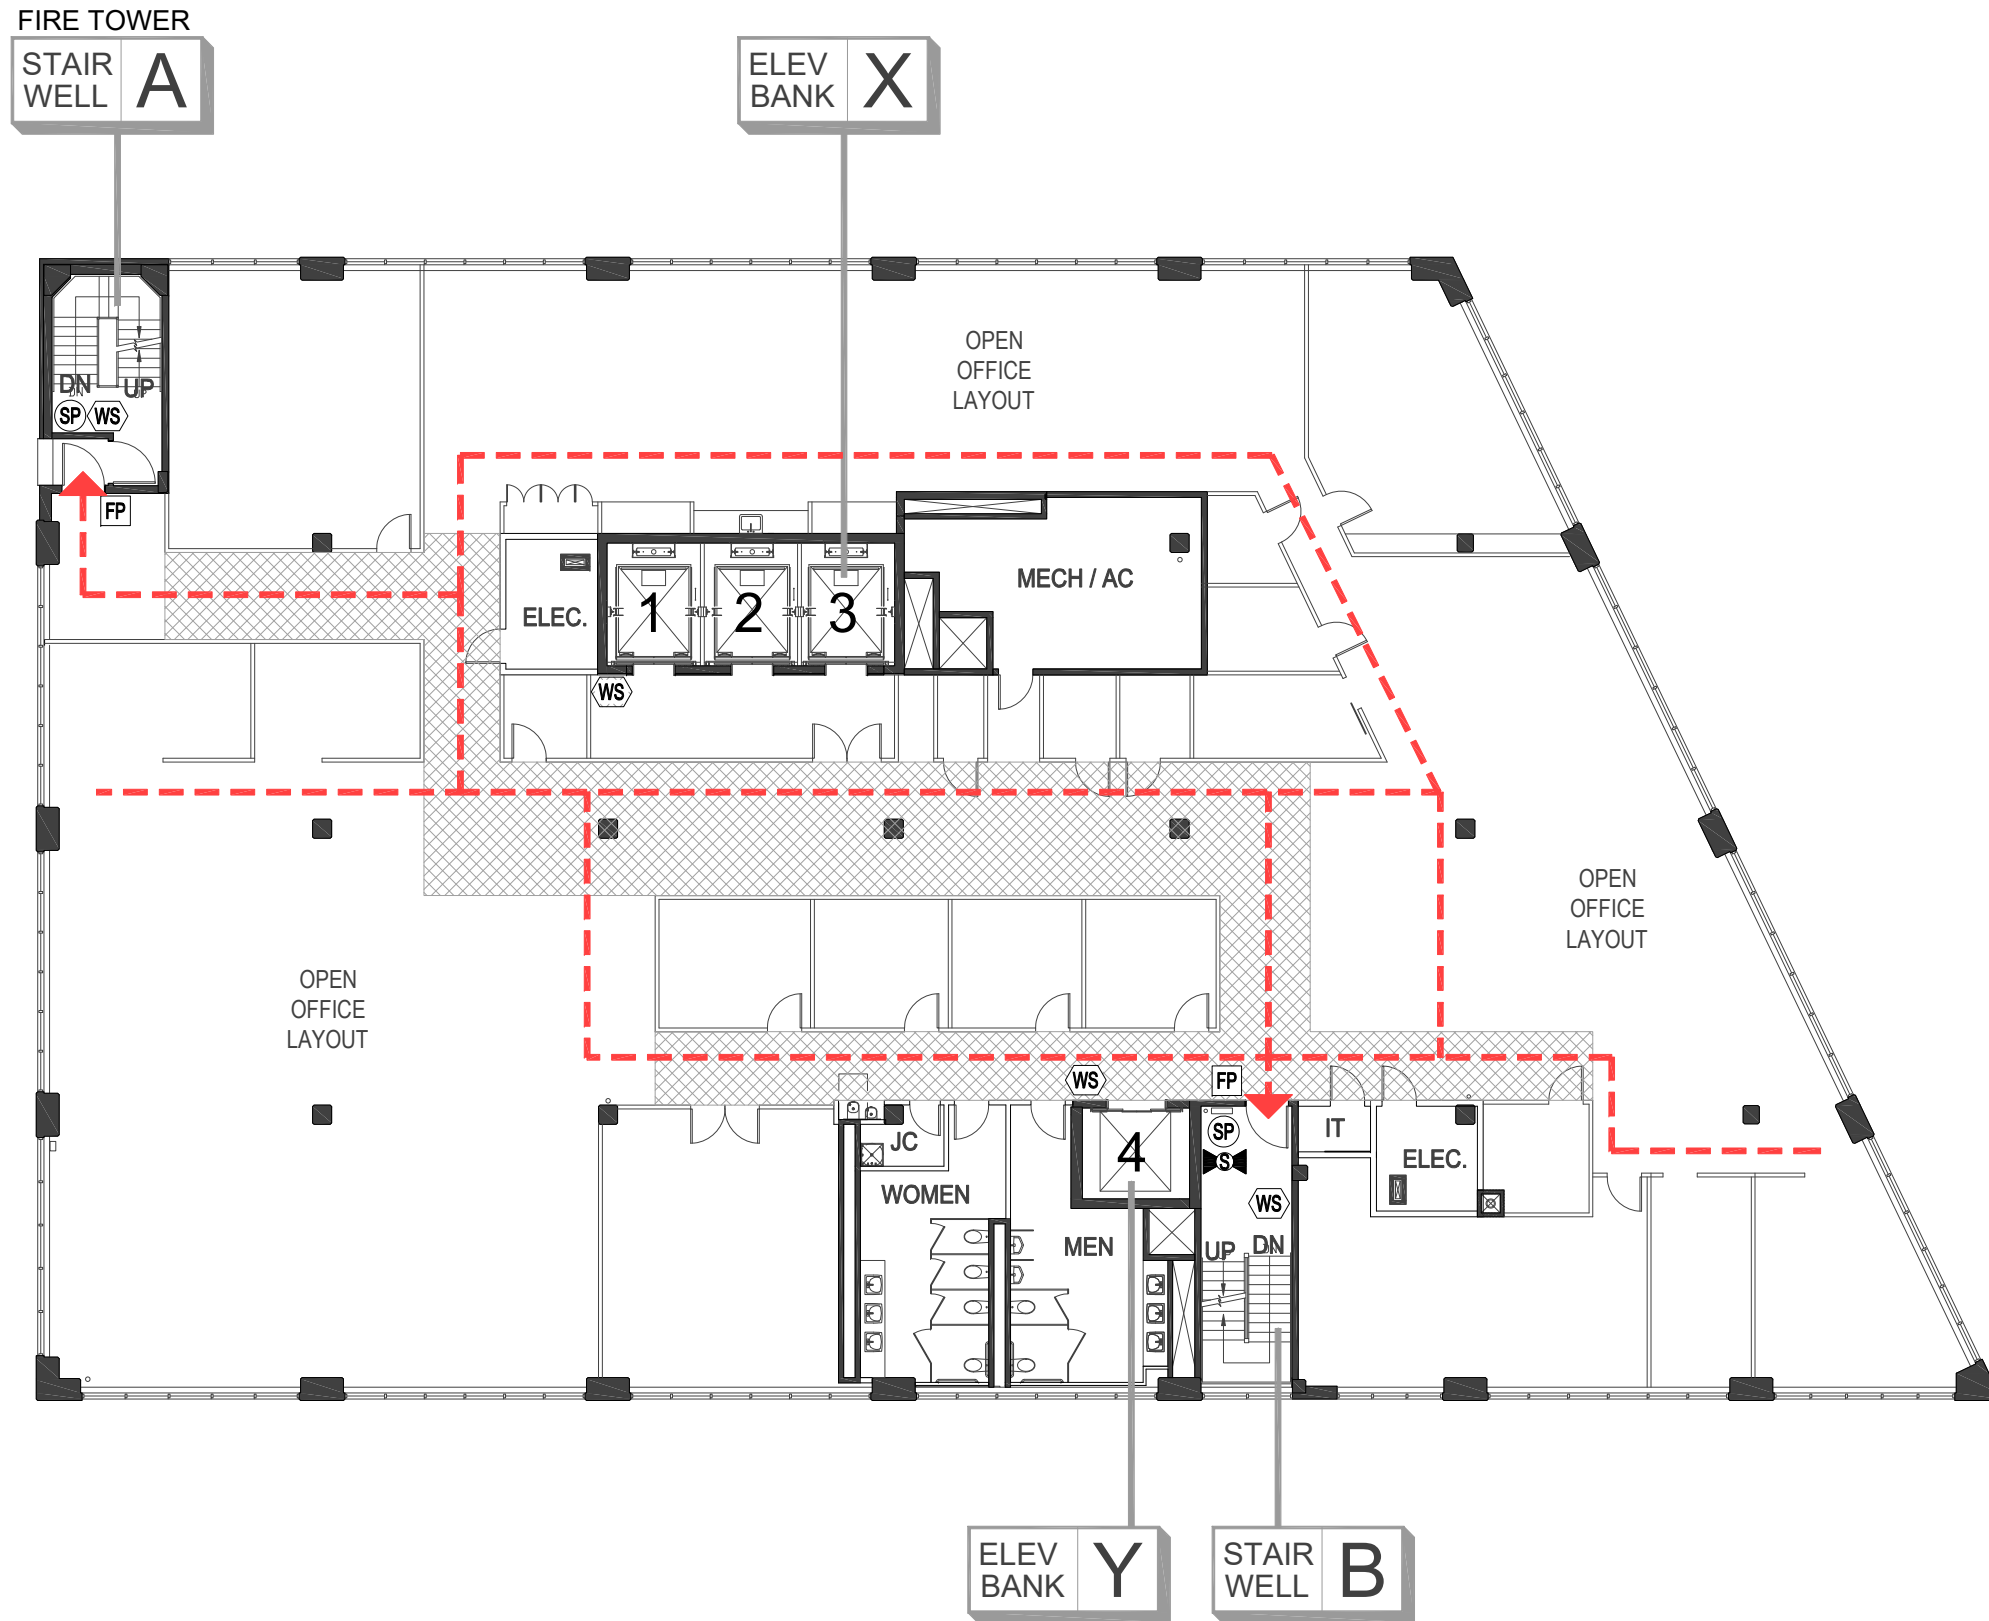

SANDS STREET

NOTE: FULL SPRINKLER COVERAGE

LEGEND

- FP MANUAL PULL STATION
- SP STANDPIPE VALVE
- FH FIRE HOSE STORAGE CABINET
- WS FIRE WARDEN STATION
- FCS FIRE COMMAND STATION
- Y FIRE DEPT. CONNECTION (SIAMESE CONNECTION)
- SP STANDPIPE CONTROL VALVE
- S SPRINKLER CONTROL VALVE
- D DOMESTIC WATER MAIN CONTROL VALVE
- C COMBINATION SPRINKLER/STANDPIPE CONTROL VALVE
- ← EVACUATION ROUTE
- FURNITURE/EQUIPMENT
- NON-RATED PARTITION
- FIRE BARRIER
- NON-SPRINKLERED AREAS (SHOWN ON FLOOR WITH PARTIAL SPRINKLER COVERAGE)
- IN-BUILDING RELOCATION AREAS (IBRA)

JAY STREET

NO.	DATE:	NAME:	ISSUED/ COMMENTS:
1	12.28.22	CF	REVISED PER LATEST SURVEY ISSUED FOR REVIEW AND FILING

DRAWN BY/DATE: AR CHECKED BY/DATE: XX/XX

BUILDING ADDRESS:
73 Sands Street
 Brooklyn, N.Y. 11201

DRAWING TITLE:
FL-11
 11th Floor

SURVEY BY: KM SURVEY DATE(S): 12.13.22